


Exhibit I - South Central Regional Water Authority drawing showing existing 30" encased 16" supply line at College St. bridge.

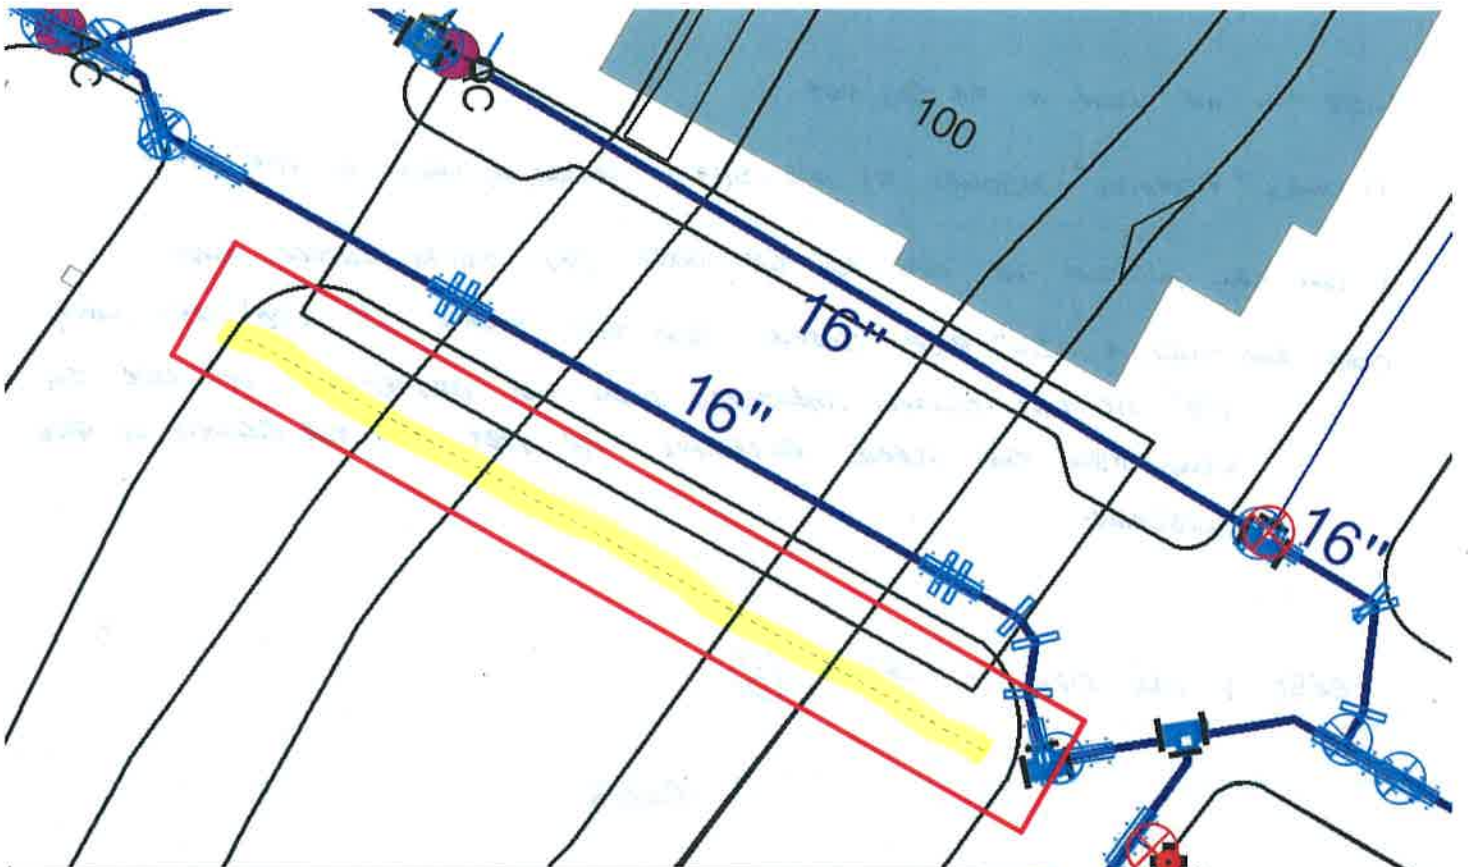

Identify from: Abandoned Man  
Maldon

Location: 950,260,595 671,493 470 Feet

Field	Value
OBJECTID	14146
Placement User ID	Maldon
Placement Source	<null>
PLACEMENTDATEIME	2/26/20 14:34:42 PM
Placement Method	<null>
Source Scale	<null>
Update User ID	Maldon
UPDATEDATEIME	1/23/20 17:20:30 PM
Update Method	<null>
X Coordinate	<null>
Y Coordinate	<null>
Subtype	AbandonedDistributionMan
RWA ID	1888317
Town Code	MIGRATE
DATINSTALLED	New Haven
Operational Status	<null>
DATEOPERATIONSTATUSCHANGED	12/14/2013
MATERIAL	Cast Iron
PolyW/rapIndicator	No
Pipe Class	Not Applicable
Buried Depth	-9.9
DIAWATER	16
Inhibitor Coating	Factory Cement Lined
DATLINED	<null>
In Private ROW	No
Installed By	<null>
Pipe Order	
Injury Number	
Legacy Feature ID	MALCOON_CRRISO11025163130
Legacy WMA Type	WMA/IN
Shape	Polyline
SHAPE_LEN	207.000012

Maldon

